



IMPORTANT INSTALLATION NOTES:


- FIXTURE TO BE INSTALLED IN ACCORDANCE WITH ALL APPLICABLE CODES BY A QUALIFIED ELECTRICIAN OR OTHER PERSON FAMILIAR WITH THE CONSTRUCTION AND OPERATION OF THIS PRODUCT AND THE HAZARDS INVOLVED.
- FIXTURE(S) MUST BE INSTALLED PRIOR TO CEILING.
- INSURE ALL HANGING POINTS ARE IN LINE WITH THE CENTERLINE OF THE FIXTURE RUN. IF THEY ARE NOT PROPERLY ALIGNED, THE RUN WILL NOT HANG STRIAIGHT.
- HANG INDIVIDUAL OR START FIXTURE SECTIONS FIRST. THESE WILL USE (4) THREADED RODS AND BE SELF SUPPORTING. TAKE CARE TO LEVEL THE FIXTURE AT THIS POINT, ESPECIALLY FOR CONTINUOUS RUNS.
- FOR CONTINUOUS RUNS, HANG EACH SUCCESSIVE SECTION USING (1) ADDITIONAL INSTALLED THREADED ROD AT PRE-DETERMINED LOCATION AND THE JOINING AND ALIGNING HARDWARE PROVIDED WITH THE FIXTURES, AND LEVEL EACH SECTION WITH THE PREVIOUS ONE.
- *****DO NOT ATTEMPT TO BOLT FIXTURES TOGETHER AND RAISE THE ASSEMBLED RUN AT ONE TIME. THIS WILL DAMAGE THE BRACKETRY AND PREVENT THE FIXTURES FROM JOINING TIGHTLY, AND WILL VOID THE FIXTURE WARRANTY!*****
- FOLLOW THE SAME PROCEDURE ABOVE TO INSTALL THE END UNIT.
- RECHECK ALL FIXTURES FOR LEVEL AND INSURE ALL JOINTS ARE TIGHT.
- IF SMALL GAPS OCCUR BETWEEN FIXTURE SECTIONS, APPLY A SMALL AMOUNT OF CAULK BETWEEN SECTIONS AND WIPE OFF EXCESS WITH A DAMP CLOTH.

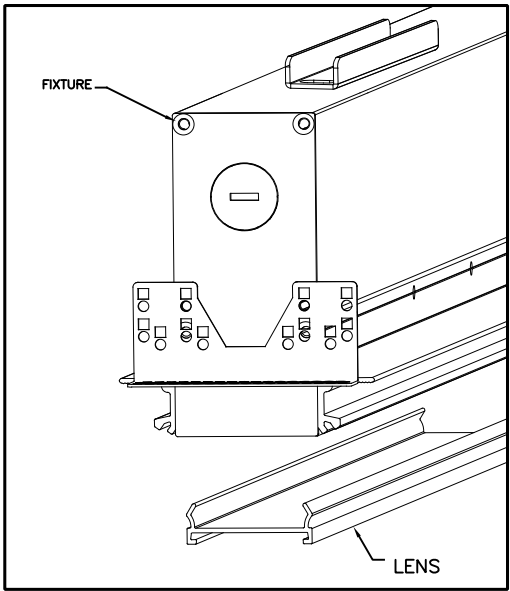

STEP 1:
-MARK EACH LENS TO
CORRESPONDING FIXTURE AND PUT
ASIDE TO BE REINSTALLED IN STEP
10.
*NOTE- FIXTURE AND LENS SHIPPED
IN SAME BOX BUT UNINSTALLED.

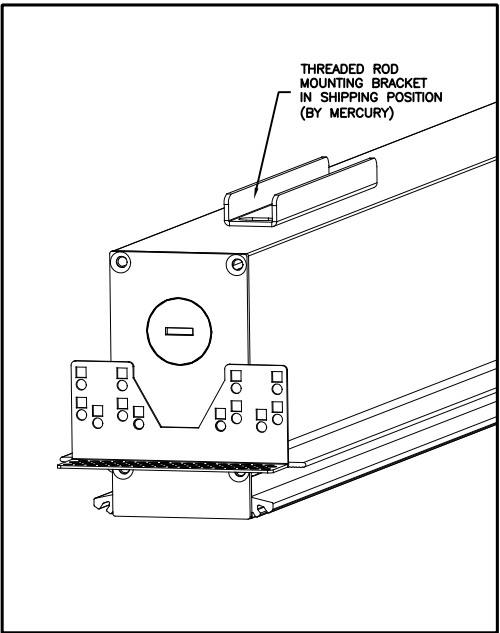

STEP 2:
-PREPARE FIXTURE FOR INSTALLATION BY ROTATING
THE THREADED ROD MOUNTING BRACKET 90 DEGREES

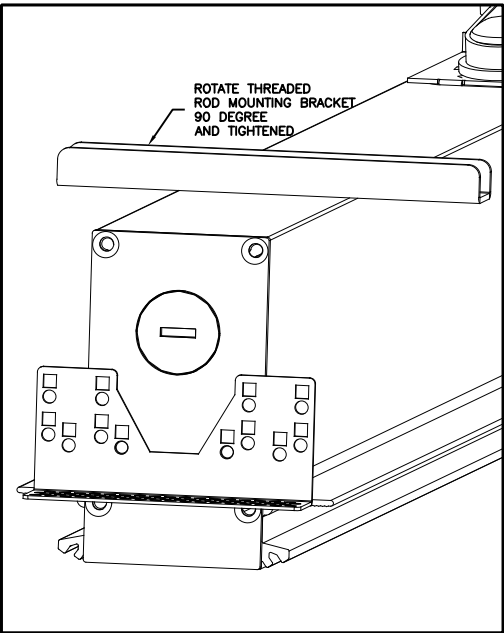


Project: MLR3-N5 TRIMLESS/DRYWALL INSTALLATION INSTRUCTION			
Distributor:		Type:	
By:	Date:	Scale:	
Dwg. no.:	Rev.	Size:	




20 Audrey Place Fairfield, NJ 07004 U.S.A.


CATALOG NO:
MLR3-XX-72-750-830K-HTA-XXX-U-S

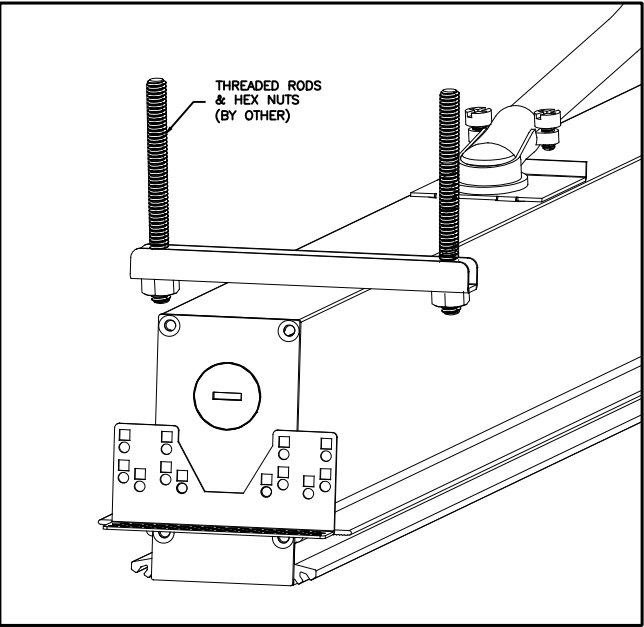


STEP 3:
-SECURE 1/4-20 THREADED RODS TO MOUNTING
BRACKET WITH HEX NUTS.
-SECURE FIXTURE TO STRUCTURE ABOVE.
-CONTINUE TO STEP 4 & 5 FOR CONNECTING MORE
THAN MIDDLE AND END.
-GO TO STEP 6 FOR 'INDIVIDUAL' MODULE

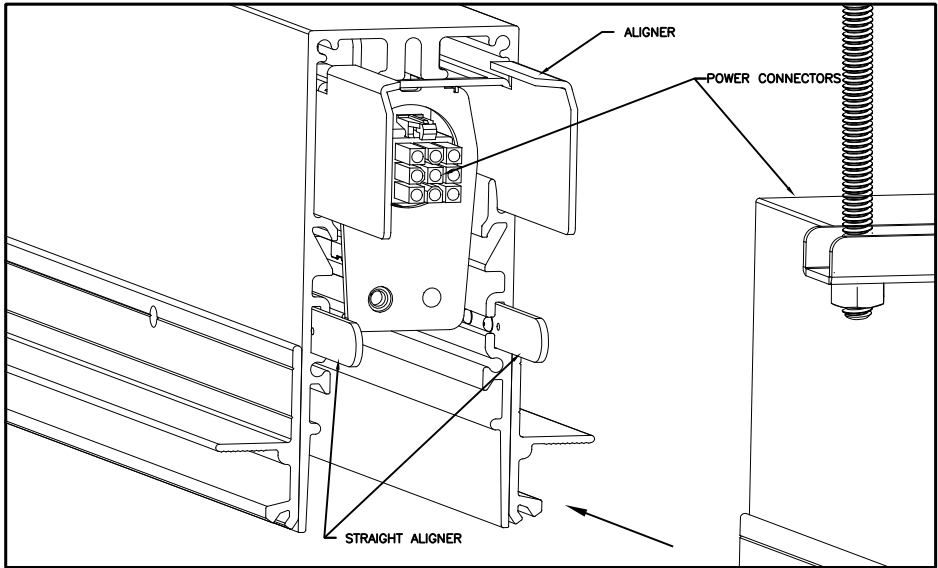


STEP 4
-ALIGN FIXTURE USING ALIGNERS BY MERCURY
-CONNECT POWER CONNECTORS BETWEEN FIXTURES

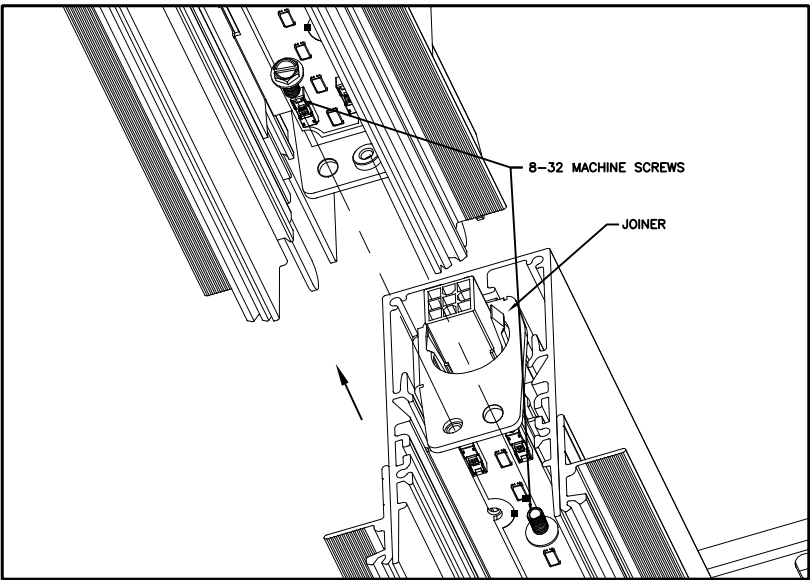


STEP 5
-PUSH EXCESS POWER CONNECTOR CABLE
BACK INTO FIXTURE THROUGH JOINERS AS
SHOWN FOR MLS-2 OR TO EITHER SIDE OF
JOINER FOR MLS-3
-SECURE FIXTURES TOGETHER USING 8-32
SCREWS ON JOINER (PROVIDED BY MERCURY).
-REPEAT STEP 2 & 4 AS NEEDED UNTIL THE
'END' MODULE IS INSTALLED

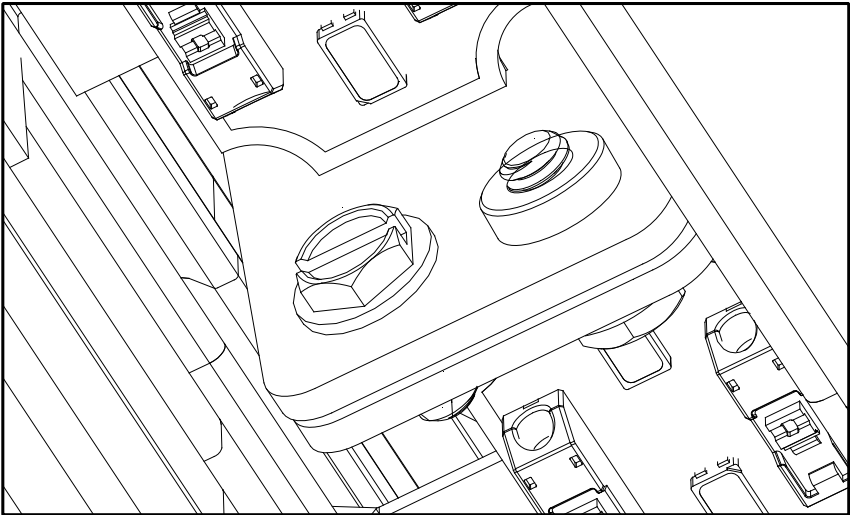

COMPLETE JOINT ASSEMBLY

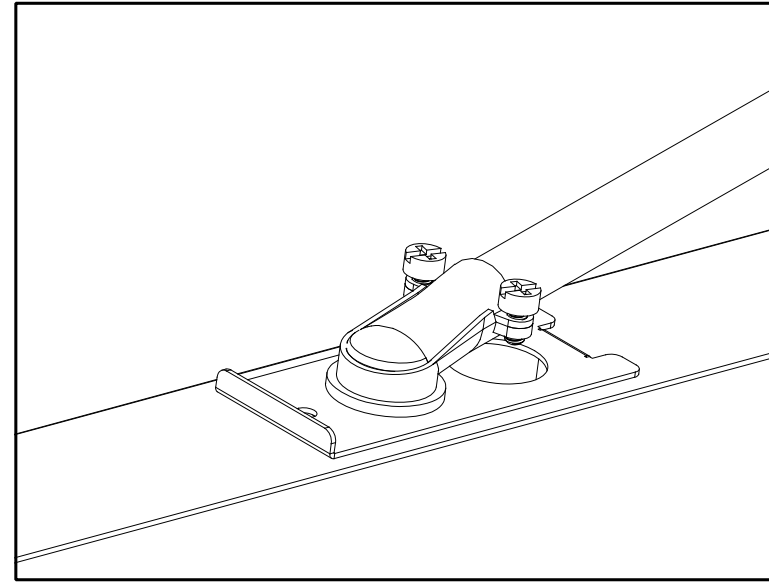

STEP 6
—MAKE ELECTRICAL CONNECTION TO BUILDING
SUPPLY.

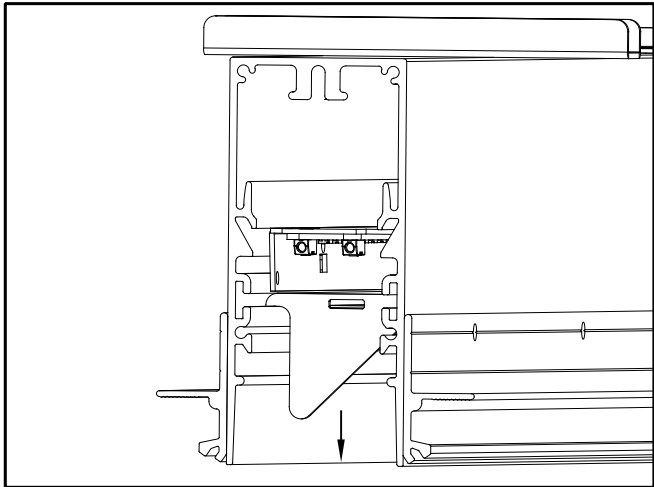


STEP 7
—MAKE SURE BRACKET IS DOWNWARD 90 DEGREES
UNTIL FLAT SIDE OF BRACKET IS PERPENDICULAR TO
CEILING.
(SHIPPED INSIDE THE FIXTURE)

Project: MLR3-N5 TRIMLESS/DRYWALL INSTALLATION INSTRUCTION			
Distributor:		Type:	
By:	Date:	Scale:	
Dwg. no.:		Rev.	Size:





20 Audrey Place Fairfield, NJ 07004 U.S.A.

CATALOG NO:
MLR3-XX-72-750-830K-HTA-XXX-U-S

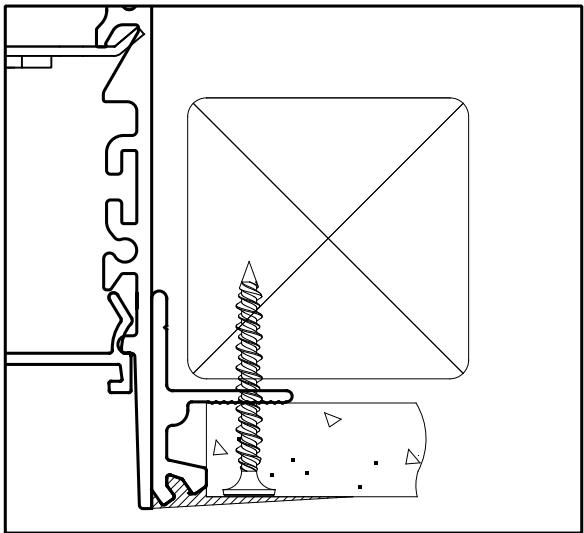

STEP 8
—INSTALL DRYWALL AROUND FIXTURE WITH
DRYWALL SCREWS
—MUD AND BLEND EDGES

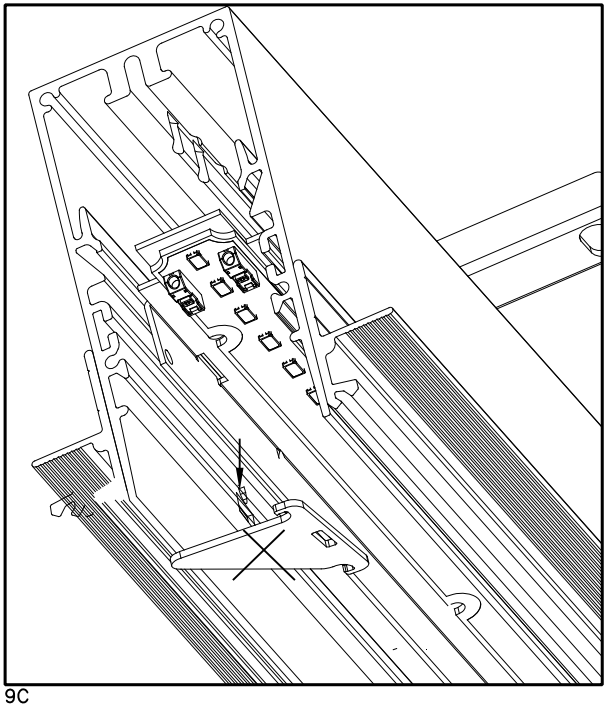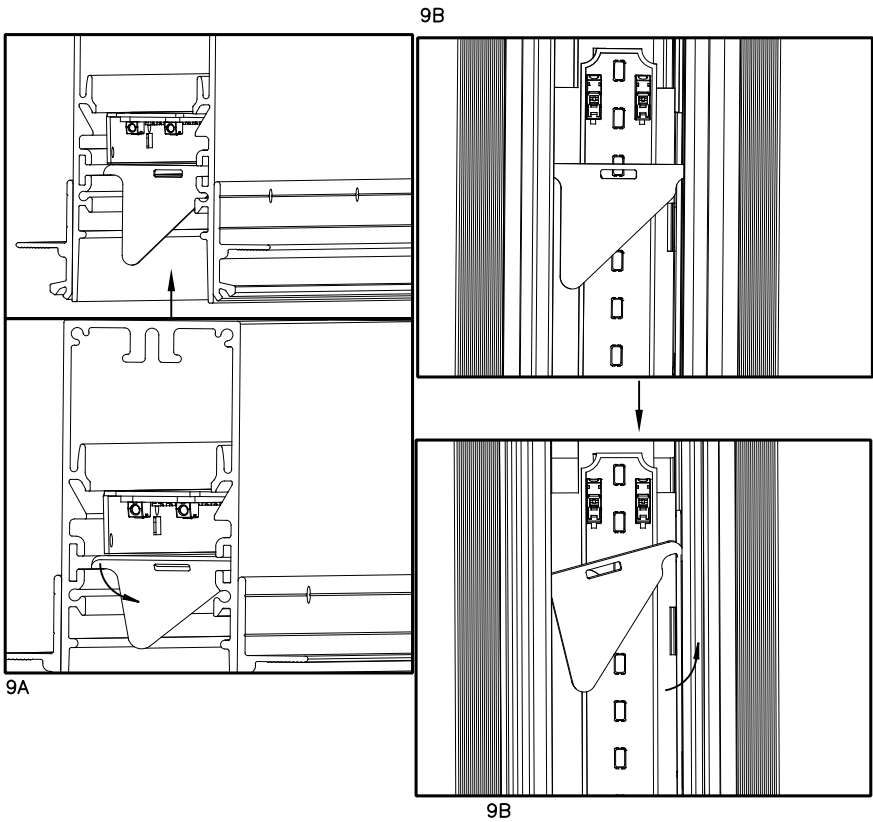


STEP 9—REMOVE TEMP BRACKET AFTER PUTTING UP
DRYWALL


STEP 9A—FLIP BRACKET UPWARD 90 DEGREES UNTIL
FLAT SIDE OF BRACKET IS PERPENDICULAR TO CEILING.

STEP 9B—USING A FLAT HEAD SCREWDRIVER, ROTATE
BRACKET COUNTERCLOCKWISE 90 DEGREES

STEP 9C—DISENGAGE BRACKET FROM GROOVE IN
HOUSING. DISCARD BRACKETS AS SHOWN

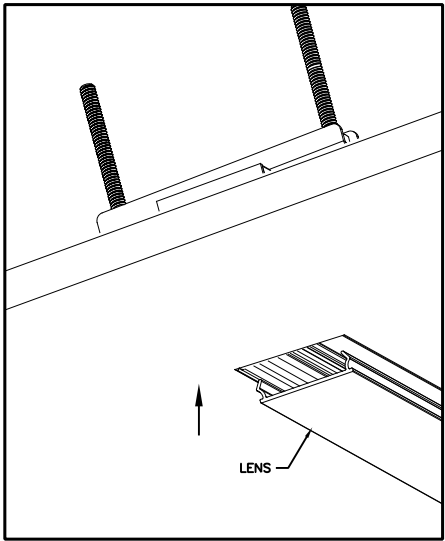

STEP 10
—REINSTALL LENSES IN SAME FIXTURES AS THEY
WERE REMOVED FROM STEP 1.

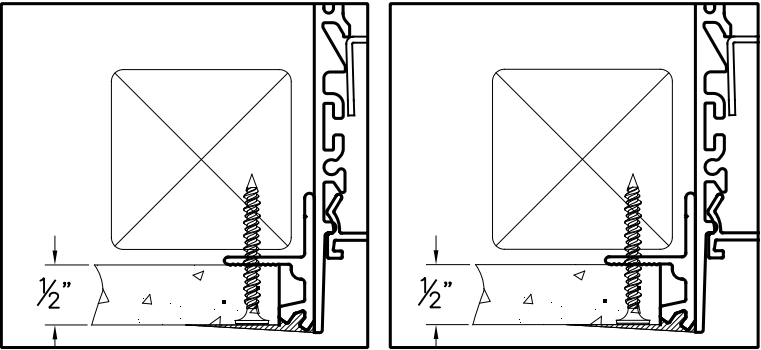

1/2" SHEETROCK 5/8" SHEETROCK

CEILING OPTIONS